Figure 4.1
Vegetated Rock Gabions

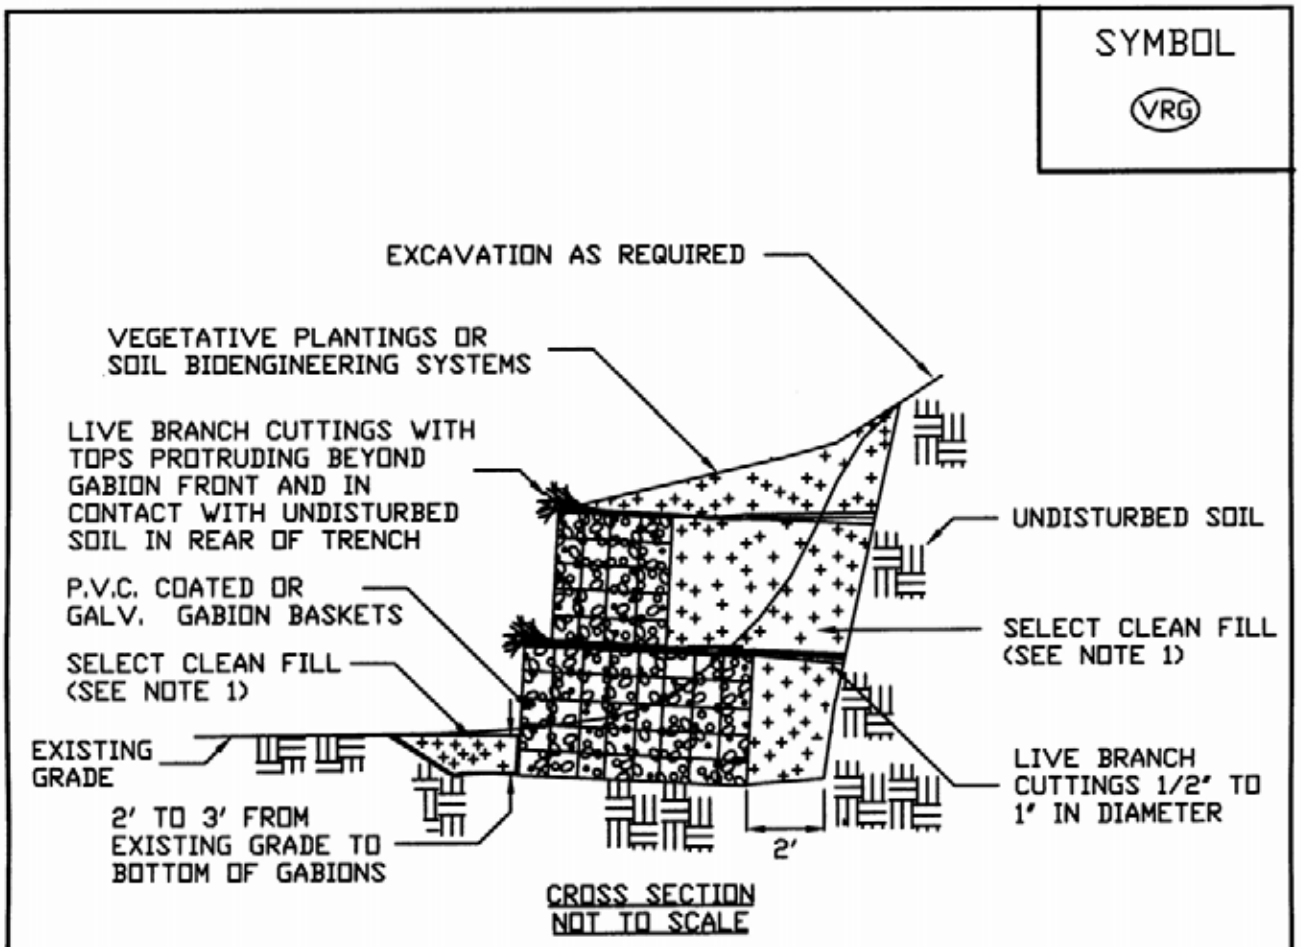

CONSTRUCTION SPECIFICATIONS

1. BACKFILL BEHIND GABIONS HAND TAMPED IN 6" LIFTS.
2. A 1" LAYER OF BACKFILL SHALL BE PLACED ON TOP OF THE ROW OF GABIONS AND RAKED. THE CUTTINGS SHALL BE PLACED ON THE BACKFILL MATERIAL AND ANOTHER 1" LAYER OF BACKFILL SHALL BE PLACED ON THE CUTTINGS BETWEEN THE GABIONS.
3. CLASS 2, TYPE B OR C, INTERMEDIATE EROSION CONTROL PRODUCT SHALL BE INSTALLED ON THE FRONT INSIDE FACE AND ANY OTHER EXPOSED VERTICAL SURFACE OF THE GABIONS.

ADAPTED FROM DETAILS PROVIDED BY: USDA - NRCS, NEW YORK STATE DEPARTMENT OF TRANSPORTATION, NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION, NEW YORK STATE SOIL & WATER CONSERVATION COMMITTEE	VEGETATED ROCK GABIONS